




# HVAC AND VAV CONTROLLER

Product Diagrams V 1.1


Model: HVAC6-3A-T

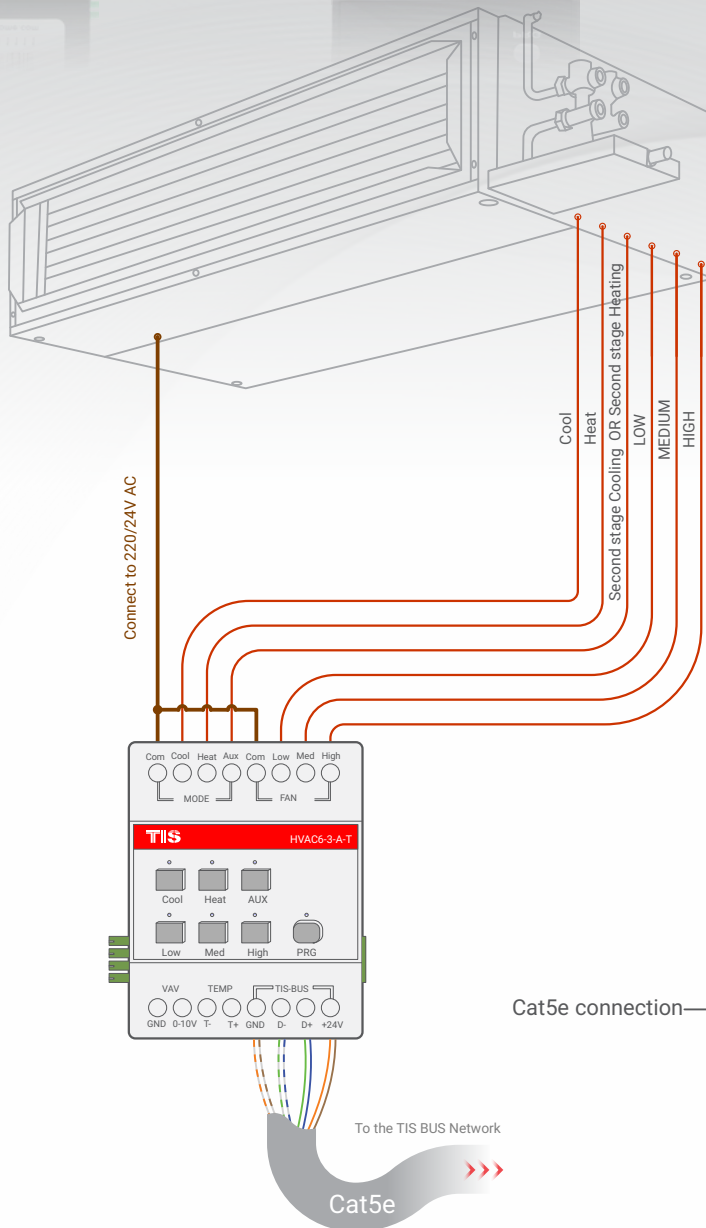

▲ Figure 1: FCU Connection Diagram

# HVAC AND VAV CONTROLLER

Model: HVAC6-3A-T

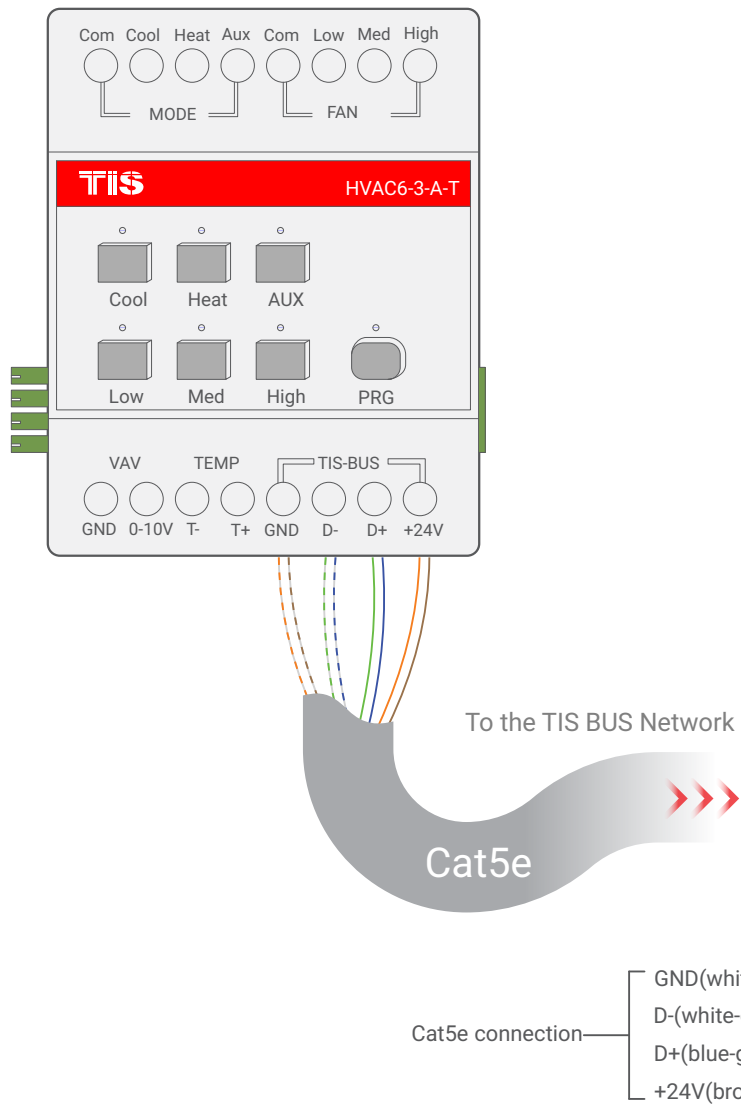

▲ Figure 2: Modules's Bus Connection Color Coding




Copyright © 2020 TIS, All Rights Reserved  
TIS Logo is a Registered Trademark of Texas Intelligent System LLC in the United States of America. This company takes TIS Control Ltd. in other countries. All of the Specifications are subject to change without notice.

TEXAS INTELLIGENT SYSTEM LLC  
SUITE# 610, 860 NORTH DOROTHY DR  
RICHARDSON  
TX 75081.USA

TIS CONTROL LIMITED  
RM 1502-p9 Easey CommBldg  
253-261 Hennessy Rd Wanchai  
Hong Kong

# HVAC AND VAV CONTROLLER

Model: HVAC6-3A-T

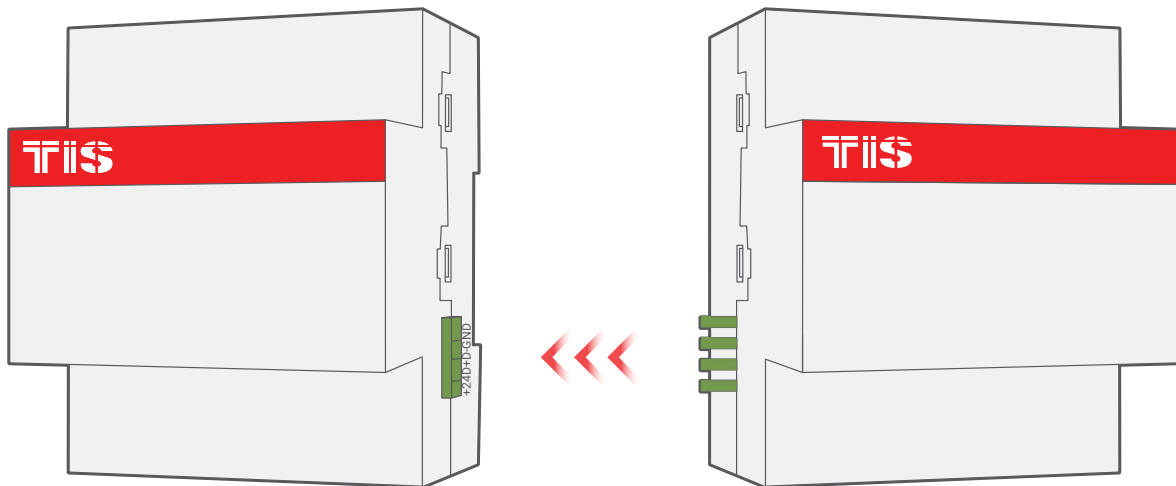

▲ Figure 3: DIN-Rail Bus Module Configuration Diagram




Copyright © 2020 TIS, All Rights Reserved  
TIS Logo is a Registered Trademark of Texas Intelligent System LLC in the United States of America. This company takes TIS Control Ltd. in other countries. All of the Specifications are subject to change without notice.

TEXAS INTELLIGENT SYSTEM LLC  
SUITE# 610, 860 NORTH DOROTHY DR  
RICHARDSON  
TX 75081.USA

TIS CONTROL LIMITED  
RM 1502-p9 Easay CommBldg  
253-261 Hennessy Rd Wanchai  
Hong Kong

# HVAC AND VAV CONTROLLER

Model: HVAC6-3A-T

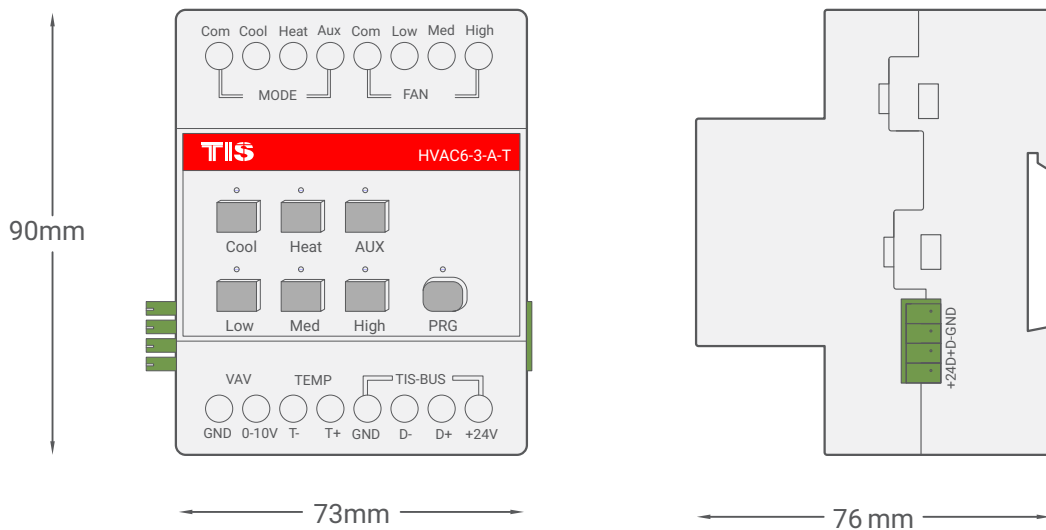

▲ Figure 4: Module's Dimensions



Copyright © 2020 TIS, All Rights Reserved  
TIS Logo is a Registered Trademark of Texas Intelligent System LLC in the United States of America. This company takes TIS Control Ltd. in other countries. All of the Specifications are subject to change without notice.

TEXAS INTELLIGENT SYSTEM LLC  
SUITE# 610, 860 NORTH DOROTHY DR  
RICHARDSON  
TX 75081.USA

TIS CONTROL LIMITED  
RM 1502-p9 Easey CommBldg  
253-261 Hennessy Rd Wanchai  
Hong Kong